








RESIDENCE FOR
MR. CARL ADAMS



OAKLEY & OAKLEY
ARCHITECTS & ENGINEERS
7700 EDGEWATER DRIVE, STE. 615
OAKLAND, CA 94621
510.562.6028
FAX: 510.562.6043

STRUCTURAL ENGINEERS:
OAKLEY & OAKLEY
7700 EDGEWATER DRIVE, SUITE 615
OAKLAND, CA 94621
Phone: 510-562-6028
Fax: 510-562-6043

CALIFORNIA GREEN CONSULTANT:
HASFRA BURT, AIA
2511 CASTRO VALLEY BLVD., SUITE 109
CASTRO VALLEY, CA 94546
510-830-4794

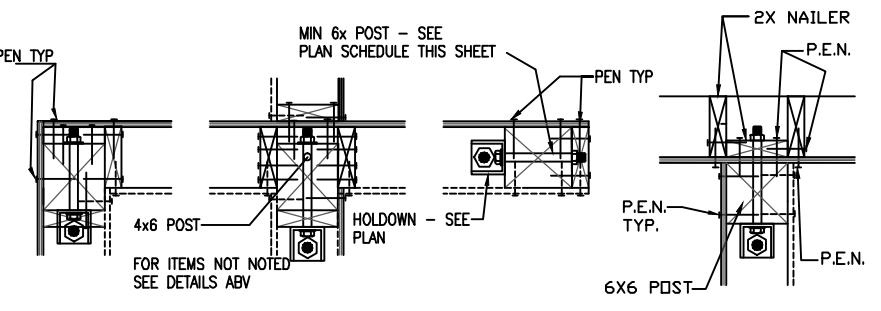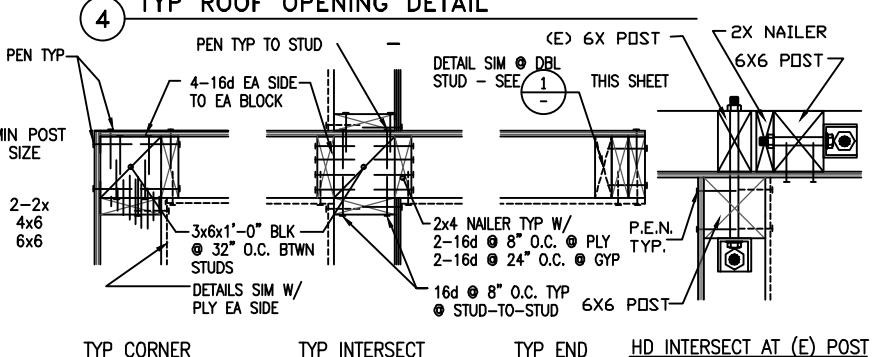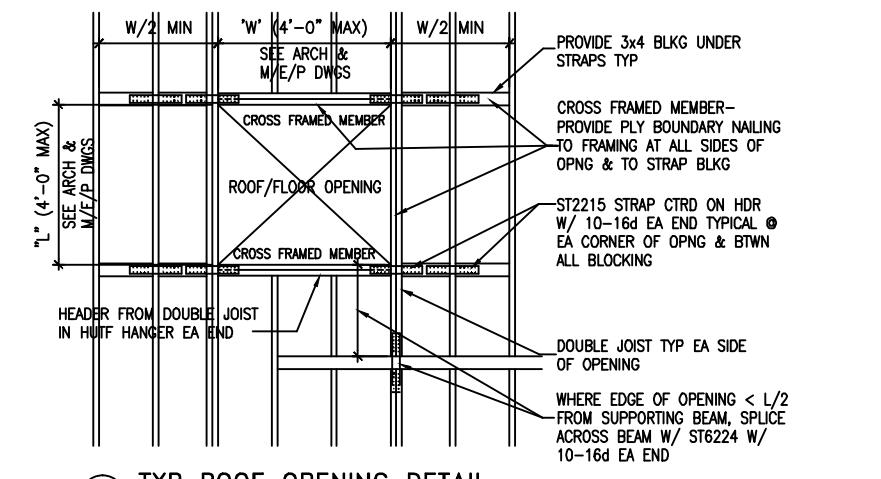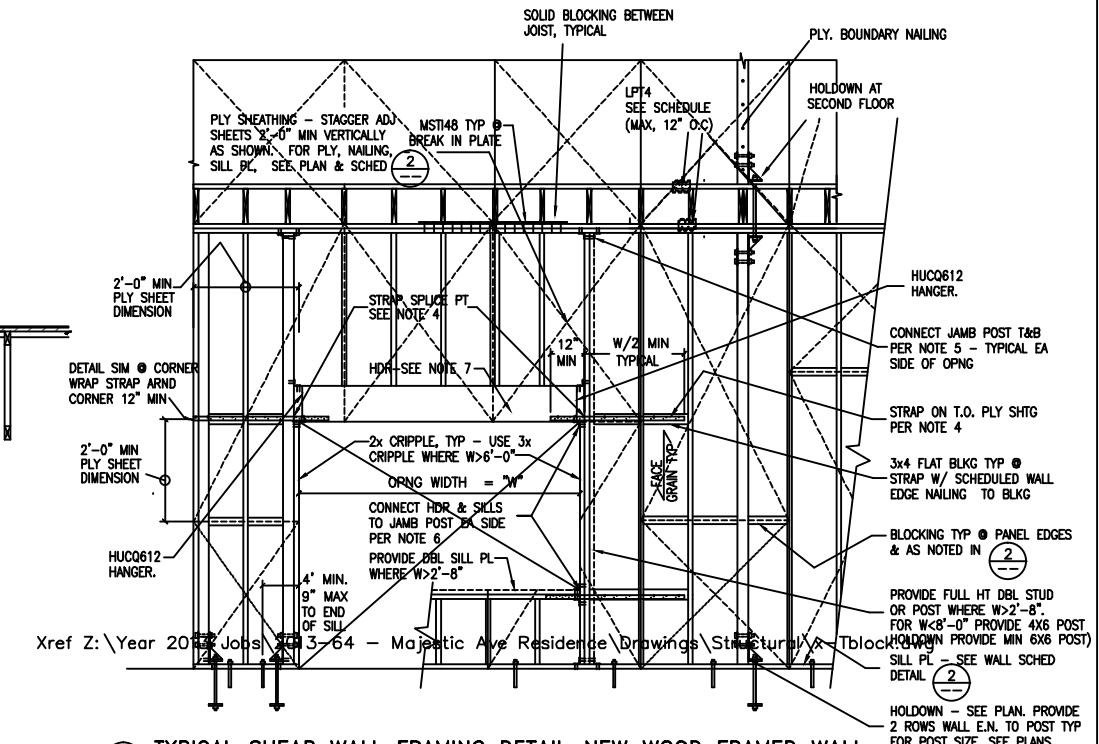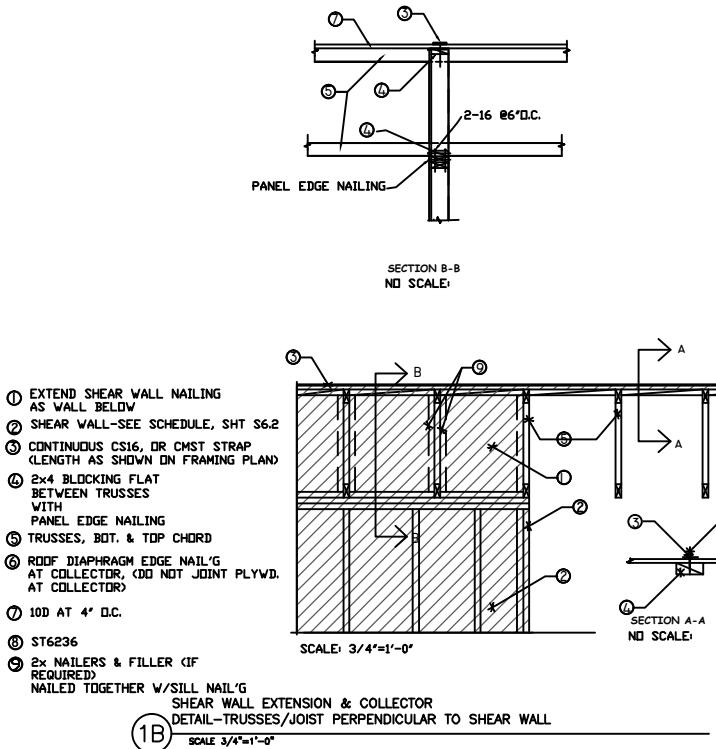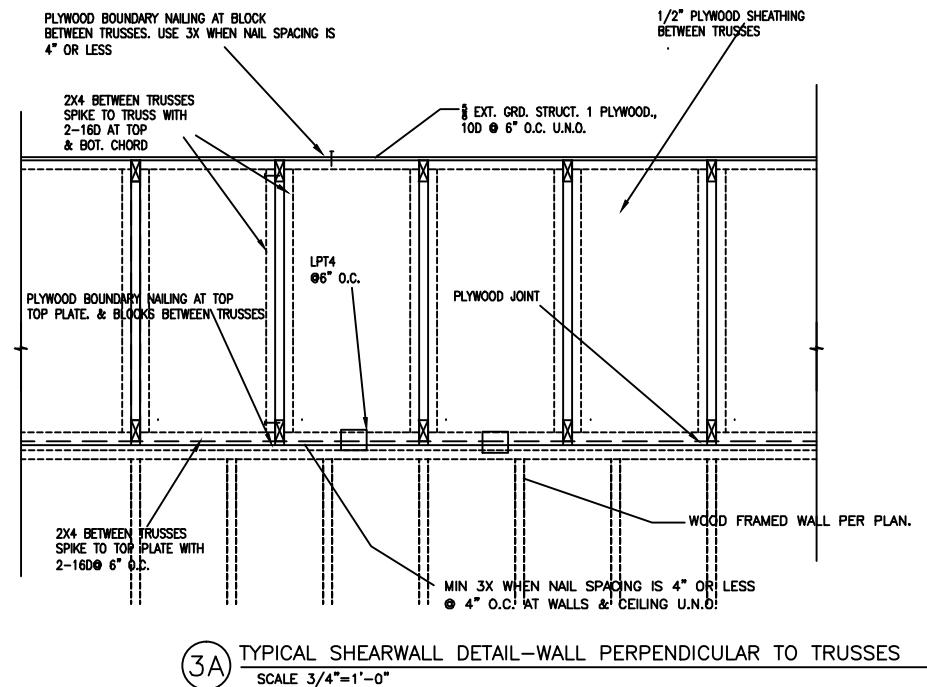

SHEAR WALL SCHEDULE

SYM.	SHEARWALL DESCRIPTION	TOP FL. TRANSFER	SILL PLATE ANCHORAGE		LPT4 OR LPT5
			ANCHOR BOLTS (SEE NOTE 11)	SILL ATTACH.	
1	15/32" CDX PLYWOOD (1) SIDE W/ 10d @ 6" o.c. USE 2x WALL AND 2x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 36" O.C.	*	• 12" O.C.
2	15/32" CDX PLYWOOD (1) SIDE W/ 10d @ 4" o.c. USE 3x WALL AND 3x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 30" O.C.	*	• 12" O.C.
3	15/32" CDX PLYWOOD (1) SIDE W/ 10d @ 3" o.c. USE 3x WALL AND 3x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 18" O.C.	3/8"X5" LONG @ 5" o.c.	• 12" O.C.
4	15/32" CDX PLYWOOD (1) SIDE W/ 10d @ 2" o.c. USE 3x WALL AND 3x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 12" O.C.	3/8"X5" LONG @ 4" o.c.	• 6" O.C.
5	15/32" CDX PLYWOOD (2) SIDE W/ 10d @ 6" o.c. USE 2x WALL AND 2x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 36" O.C.	*	• 6" O.C.
6	15/32" CDX PLYWOOD (2) SIDE W/ 10d @ 4" o.c. USE 3x WALL AND 3x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 30" O.C.	*	• 6" O.C. AT EA. SIDE
7	15/32" CDX PLYWOOD (2) SIDE W/ 10d @ 3" o.c. USE 3x WALL AND 3x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 18" O.C.	3/8"X5" LONG @ 5" o.c.	• 6" O.C. AT EA. SIDE
8	15/32" CDX PLYWOOD (2) SIDE W/ 10d @ 2" o.c. USE 3x WALL AND 3x SOLE PLATE.	SEE PLAN	3/4" A.B. AT 12" O.C.	3/8"X5" LONG @ 4" o.c.	• 6" O.C. AT EA. SIDE
9	12" WIDE HARDY PANEL	SEE SHT S5	SEE SHT S5	SEE SHT S5	SEE SHT S5
10	24" WIDE HARDY PANEL (HF9x24 1-1/8)				


NOTES.

1. NOT USED.
2. APA RATED PANELS SHALL BE CDX OF THE FOLLOWING MATERIALS:
PLYWOOD (NER-108)
ORIENTED STRAND BOARD (NER-Q397)
WAFFLEBOARD (NER-124)
3. NAILING INDICATED IS TYP. EDGE NAILING FOR FIELD NAILING
10d @ 12" O.C.
4. ALL HOLDOWNS EXCEPT MA4 ARE PLACED ON 6x6 POSTS
TYP. U.N.O.
5. STAGGER JOINT AND SILL & NAILING.
6. NOT USED
7. FURNISH 3x MEMBERS AT ALL SHEAR WALLS, TYP. U.N.O.
8. NAILS SHALL BE STAGGERED ON EACH SIDE OF SIDE OF STUD WHERE PLYWOOD PANELS ARE APPLIED ON BOTH SIDES OF WALL
9. * = NOT APPLICABLE
10. NOT USED
11. AT ALL ANCHOR BOLTS AT SILL PLATES PROVIDE A MINIMUM 3X3X0.229 THK PLATE WASHER WITH NUT.

NOTE:

UNDERDRIVEN NAILS ARE REQUIRED TO BE DRIVEN BY HAMMER SO THAT THE HEAD OF THE NAIL IS FLUSH WITH THE TOP SURFACE OF THE PLYWOOD.
MACHINE NAILING SHALL BE USED ONLY WHERE THE BACK SIDE CAN BE INSPECTED FOR "SHINERS".
"SHINERS" OR NAILS WHICH DO NOT PENETRATE FULLY INTO FRAMING OR BLOCKING SHALL BE REMOVED AND REPLACED. ALL REMEDIAL NAILING SHALL BE BY HAND.
IF ANY FRAMING MEMBERS, BLOCKING OR JOISTS RECEIVING THE POINTS OF NAILS, ARE DAMAGED (SPLIT, NAILS HIT TO CLOSE, ETC.) THEY SHALL BE REMOVED AND REPLACED.
GUN NAILING FOR TOE NAIL, END NAIL AND SLANT DRIVEN NAIL ARE NOT PERMITTED.

(2) SHEAR WALL SCHEDULE & NOTES

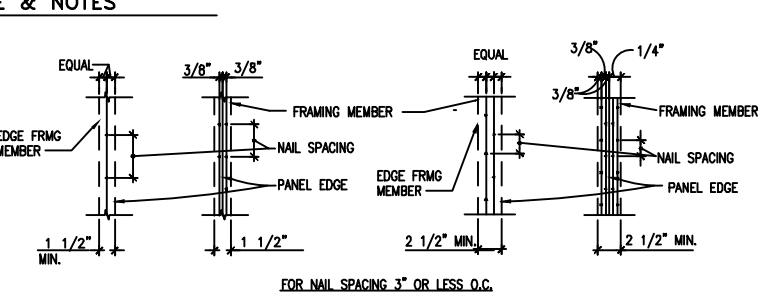

(3) TYP. PLYWOOD EDGE NAILING

SCOPE OF WORK IS FOR FOUNDATION, FOUNDATION PIERS, FOUNDATION BOLTS, AND PLATE ANCHOR BOLTS ONLY

OWNER:
MR. CARL ADAMS
6333 JERILYN ANENUE
RICHMOND, CA 94806

TYPICAL SHEAR WALL DETAILS

Project number 2013-63

Date 1/17/2014

Drawn by STAFF

Checked by J.O.

Scale AS NOTED

S6.2